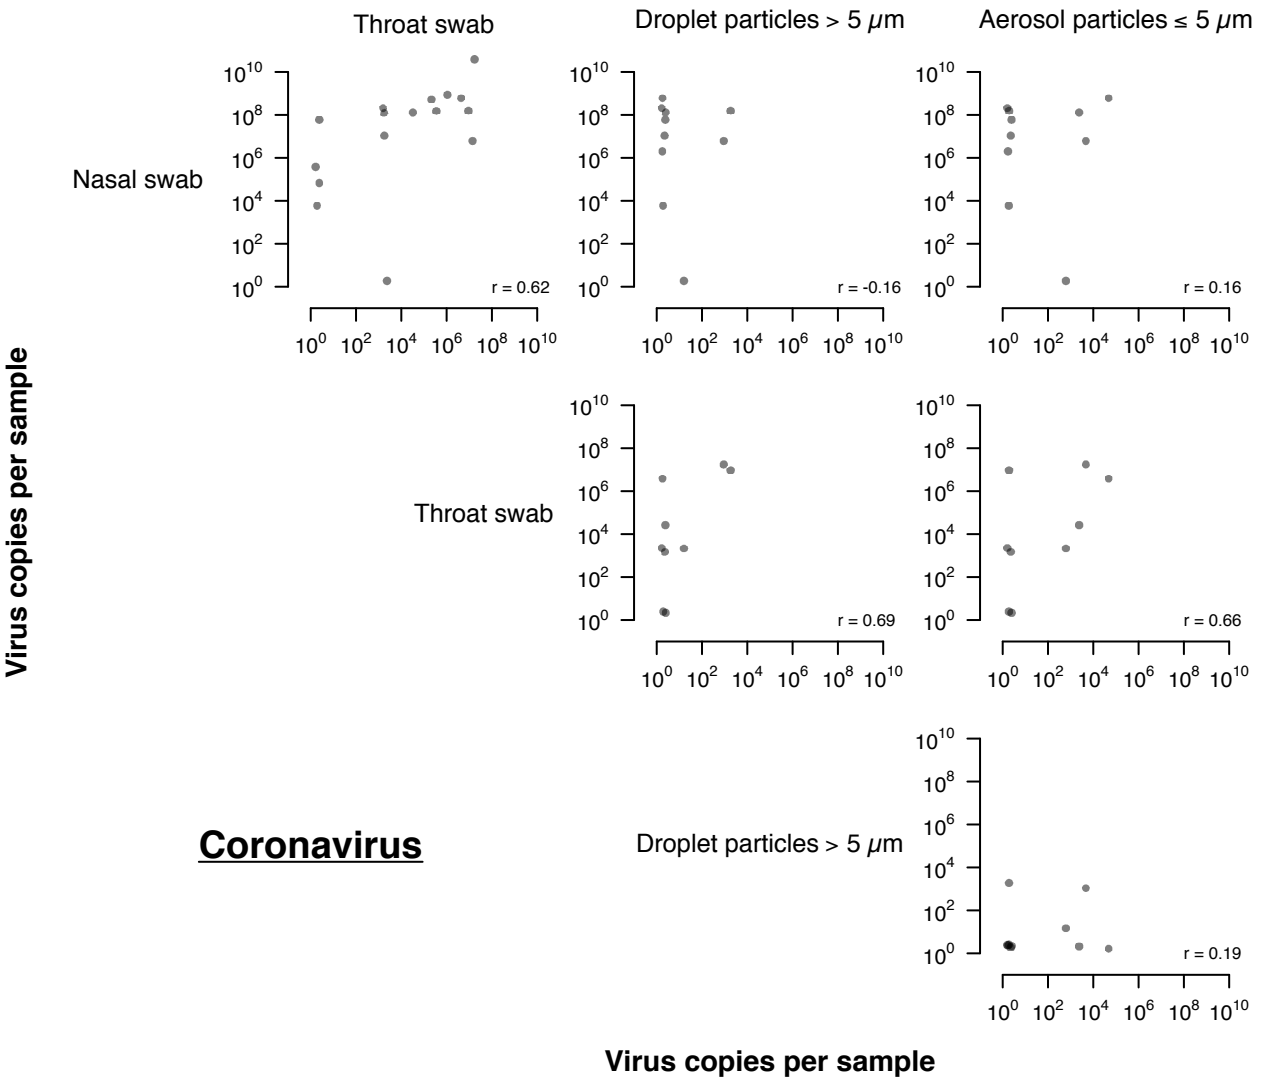
Throat swab
Droplet particles > 5 μm
Aerosol particles ≤ 5 μm
Nasal swab
Throat swab
Droplet particles > 5 μm
r = 0.62
r = -0.16
r = 0.16
r = 0.69
r = 0.66
r = 0.19
Coronavirus
Virus copies per sample
Virus copies per sample