



## Use of Local Exhaust Ventilation to Control Aerosol Exposures Resulting from the Use of a Reciprocating Saw During Autopsy

Kenneth Martinez , Randy L. Tubbs , Philip Ow & Dawn Tharr

To cite this article: Kenneth Martinez , Randy L. Tubbs , Philip Ow & Dawn Tharr (2001) Use of Local Exhaust Ventilation to Control Aerosol Exposures Resulting from the Use of a Reciprocating Saw During Autopsy, Applied Occupational and Environmental Hygiene, 16:7, 709-717

To link to this article: <https://doi.org/10.1080/10473220117301>



Published online: 30 Nov 2010.



Submit your article to this journal [↗](#)



Article views: 36



View related articles [↗](#)



Citing articles: 1 View citing articles [↗](#)

## Case Studies

# Use of Local Exhaust Ventilation to Control Aerosol Exposures Resulting from the Use of a Reciprocating Saw During Autopsy

*Dawn Tharr, Column Editor*

Reported by Kenneth Martinez, Randy L. Tubbs, and Philip Ow

The National Institute for Occupational Safety and Health (NIOSH) received a request to conduct a health hazard evaluation (HHE) from a coroner's office. Specifically, the request was for NIOSH assistance in evaluating a pneumatic reciprocating saw, equipped with local exhaust ventilation (LEV), used for cranial openings during forensic autopsies and examinations. The pneumatic saw was being evaluated by the coroner's office as an alternative to the electrically-driven reciprocating saw. The objective of the NIOSH evaluation was to determine if the reciprocating saw 1) generated less tissue and bone fragment aerosol that could potentially challenge the breathing zone of the operating forensic technician, and 2) reduced the noise exposure to the technician and surrounding personnel. The NIOSH investigation included real-time area and personal measurement of airborne particulates, and real-time spectral measurement of noise during the conduct of six autopsies (four autopsies for the noise evaluation). The investigation was conducted in cooperation with the County Health Department, who simultaneously collected particulate air samples for microscopic analysis of bone and tissue fragments.

## Background

During a six month period, two active cases of tuberculosis (TB) and 10 tuberculin skin test (TST) conversions among employees were reported by the coroner's office. Additionally, one case

of active disease was diagnosed in a general relief worker operating as a janitor for the building. An epidemiologic assessment concluded that a high risk of TB infection was evident for coroner office employees.<sup>(1)</sup> Autopsy room workers were five times more likely to develop TB infection than other employees. Employee to employee transmission was ruled out in the outbreak, however, the possible transmission of disease from the cadaver to employees could not be ruled out.

The coroner's building was concrete and glass construction, and was approximately 27 years old. The overall ventilation systems were reported to be functioning at 75 percent of design capacity with many of the components in need of maintenance and repair.<sup>(1)</sup> Autopsies were primarily conducted in three rooms; the main rooms had table capacities for five and six simultaneous autopsies, while a smaller room had a capacity for three. The smaller of the three autopsy rooms was designated for cases suspected of human immunodeficiency virus (HIV) or TB infection. A test and balance of the ventilation systems serving the autopsy rooms indicated that the main autopsy room was under negative pressure (having approximately 20 air changes per hour [ACH]), whereas, the smaller autopsy room was under positive pressure. As a result, a separate exhaust system was installed in the small autopsy room to place it under negative pressure relative to the corridor, achieving a maximum air change rate of approximately 24 ACH.

In addition to the changes made to the ventilation system in the small autopsy

room, the coroner initiated a study evaluating the implementation of a pneumatically driven reciprocating saw (Salam International Model 1100, Laguna Niguel, CA) equipped with LEV to reduce occupational exposures to blood and other bodily fluids. If effective, the pneumatic saw would replace an electrically-driven saw (Stryker Model 810) that was currently being used. The pneumatic saw operated at a speed of 19,000 cycles per minute (cycles/min), whereas, the electric saw operated at a speed of 17,000 cycles/min. The LEV on the pneumatic model consisted of a hood and spray nozzle connected to an aqueous spray/vacuum extraction system. The aqueous spray/vacuum extraction system was physically located in adjacent space (i.e., the building garage) to the small autopsy room. The holding tank on the vacuum extraction system contained a 10 percent bleach solution to decontaminate incoming materials. Additionally, the exhaust on the vacuum extraction system was equipped with an internal high efficiency particulate air (HEPA) filter.

## Methods

### *Particulates*

Real-time sampling for airborne particulates was conducted with three light-scattering instruments: the Grimm Model 1105 Dust Monitor (Labortechnik GmbH & CoKG, Ainring, Germany); the Met-One Model 227 Hand-Held Particle Counter (Met-One, Inc., Grants Pass, OR); and the Handheld Aerosol Monitor (HAM [PPM, Inc., Knoxville, TN]). The Grimm Dust Monitor is a light scattering aerosol spectrometer designed for

real-time particulate measurement with particle size discrimination. Eight channels collect count information for particle sizes greater than 0.75, 1, 2, 3.5, 5, 7.5, 10, and 15 micrometers ( $\mu\text{m}$ ). The Met-One Particle Counter counts particles simultaneously using a solid state laser diode in two size ranges (0.3 and 1  $\mu\text{m}$  were selected for this survey) at an operating flow rate of 2.8 liters per minute (lpm). The HAM uses near-forward scattering of infrared light with an instrument response designed to fit the respirable aerosol fraction. Data were collected during six autopsies to monitor the particulates generated by distinct events. The monitor's probe inlets were mounted approximately 15 centimeters above the forehead of the decedent. For each autopsy, data were integrated for one second (sec) and stored sequentially on the Grimm data card over the entire time period. The collected particle count and size information was downloaded to a laptop computer following the completion of the autopsy. Start and stop times for significant autopsy events were recorded during each sample collection period.

### Noise

Real-time area noise sampling was conducted with a Larson-Davis Laboratory Model 2800 Real-Time Analyzer, equipped with Larson-Davis Laboratory Model 2559 $\frac{1}{2}$ -inch random incidence microphone. This instrument allows for the analysis of noise into its spectral components in a real-time mode. The one-third octave center frequency bands from 8 Hertz (Hz) to 16 kilohertz (kHz) were integrated for 15 seconds and stored sequentially in the analyzer over the time period necessary for the technician to open the skull for inspection by the pathologist. An attempt was made to only store samples which contained a full 15-seconds of sawing. If the technician turned off the saw before the sample was complete, the analyzer was reset and that sample discarded. The analyzer was mounted on a tripod placed at the right side of the autopsy table next to the cadaver's head, with the microphone at ap-

proximately the level of the technician's ear while he was using the saw. Ambient noise levels in the room, while the saw was not in use, were also stored for each of the cadavers that were surveyed.

### Evaluation Criteria

The occupational hazards encountered by health care professionals are varied. These hazards include exposures to biologic, chemical, and physical agents, as well as ergonomic challenges posed by the manipulation and transport of patients. In 1988, NIOSH published a document that focused on protecting the safety and health of health care workers. NIOSH found that, compared to the civilian workforce, hospital workers have a greater percentage of workers' compensation claims for sprains and strains, infectious and parasitic diseases, dermatitis, hepatitis, mental disorders, eye diseases, influenza, and toxic hepatitis.<sup>(2)</sup> Probably the most occupationally unique and high risk hazards are posed by exposures to infectious agents. In some instances, the risk of occupationally acquired infections is of such concern that comprehensive, agent-focused guidelines have been published by the Centers for Disease Control and Prevention (CDC). Specifically, these guidelines have addressed occupational exposures to *Mycobacterium tuberculosis*, human immunodeficiency virus (HIV), and hepatitis B virus (HBV).<sup>(3,4)</sup> In 1991, OSHA published their final rule on occupational exposures to bloodborne pathogens.<sup>(5)</sup> The bloodborne pathogens rule is in part based on the concept of "universal precautions." Universal precautions are defined as the treatment of all human blood and certain human body fluids as if known to be infectious for human immunodeficiency virus (HIV), hepatitis B virus (HBV), and other bloodborne pathogens. In 1996, OSHA developed a directive for enforcement procedures and scheduling for occupational exposures to tuberculosis.<sup>(6)</sup>

Within the health care industry, certain sectors are known to present greater exposure risk potentials to both bloodborne pathogens and tubercle bacilli.

During the conduct of autopsies, an increased risk to the pathologist and pathology technicians can result from unknown disease etiologies and potentially large infectious agent concentrations released during invasive procedures. The infectious diseases of special concern during autopsies (or more generally, infection hazards in the deceased) have included tuberculosis, hepatitis B and C virus, HIV, Creutzfeldt-Jacob disease, group A streptococcal infection, gastrointestinal organisms, and possibly meningitis and septicaemia (especially meningococcal).<sup>(7,8)</sup> Recent concerns about the increasing incidence of hantavirus pulmonary syndrome (HPS) have resulted in questions regarding the level of biosafety necessary to protect autopsy prosectors operating on decedents known to have been infected with hantavirus. Given the limited biosafety information regarding HPS and the serious consequences of infection, recommendations have been made to use biosafety level (BSL) 2 facilities and BSL 3 procedures and practices.<sup>(9)</sup> Tuberculosis has gained increasing attention as a significant exposure concern during the conduct of autopsies. Sugita et al. demonstrated an increased odds ratio (6.08–10.98) among pathologists and pathology technicians engaged in their current specialist work compared to control groups.<sup>(10)</sup> Recent case studies of outbreaks among autopsy personnel resulting from occupational exposures have been documented.<sup>(11–13)</sup>

Specific ventilation criteria for autopsy rooms in which the decedent is suspected of having an infectious disease at the time of death, currently do not exist. However, the American Society for Heating, Refrigerating, and Air-Conditioning Engineers (ASHRAE), and the American Institute of Architects (AIA), have published ventilation specific guidelines for autopsy areas.<sup>(14,15)</sup> These guidelines recommend that autopsy areas be provided with at least 12 ACH. Additionally, ASHRAE recommends a minimum contribution of two outdoor ACHs; AIA does not have a provision for the introduction of outdoor air.

## Noise

Noise-induced loss of hearing is an irreversible, sensorineural condition that progresses with exposure. Although hearing ability declines with age (presbycusis) in all populations, exposure to noise produces hearing loss greater than that resulting from the natural aging process. This noise-induced loss is caused by damage to nerve cells of the inner ear (cochlea) and, unlike some conductive hearing disorders, cannot be treated medically.<sup>(16)</sup> While loss of hearing may result from a single exposure to a very brief impulse noise or explosion, such traumatic losses are rare. In most cases, noise-induced hearing loss is insidious. Typically, it begins to develop at 4000 or 6000 Hz (the hearing range is 20 Hz to 20000 Hz), and spreads to lower and higher frequencies. Often, material impairment has occurred before the condition is clearly recognized. Such impairment is usually severe enough to permanently affect a person's ability to hear and understand speech under everyday conditions. Although the primary frequencies of human speech range from 200 Hz to 2000 Hz, research has shown that the consonant sounds, which enable people to distinguish words such as "fish" from "fist," have still higher frequency components.<sup>(17)</sup>

The A-weighted decibel [dB(A)] is the preferred unit for measuring sound levels to assess worker noise exposures. The dB(A) scale is weighted to approximate the sensory response of the human ear to sound frequencies near the threshold of hearing. The decibel unit is dimensionless, and represents the logarithmic relationship of the measured sound pressure level to an arbitrary reference sound pressure (20 micropascals, the normal threshold of human hearing at a frequency of 1000 Hz). Decibel units are used because of the very large range of sound pressure levels which are audible to the human ear. Because the dB(A) scale is logarithmic, increases of 3 dB(A), 10 dB(A), and 20 dB(A) represent a doubling, tenfold increase, and 100-fold increase of sound energy, respectively. It should be noted that noise exposures expressed in decibels cannot

be averaged by taking the simple arithmetic mean.

The OSHA standard for occupational exposure to noise (29 CFR 1910.95) specifies a maximum PEL of 90 dB(A) for a duration of eight hours per day.<sup>(18)</sup> The regulation, in calculating the PEL, uses a 5 dB time/intensity trading relationship, or exchange rate. This means that a person may be exposed to noise levels of 95 dB(A) for no more than four hours, to 100 dB(A) for two hours, and so. Conversely, up to 16 hours exposure to 85 dB(A) is allowed by this exchange rate. The duration and sound level intensities can be combined in order to calculate a worker's daily noise dose according to the formula

$$\text{Dose} = 100 \times \left( \frac{C_1}{T_1} + \frac{C_2}{T_2} + \dots + \frac{C_n}{T_n} \right),$$

where  $C_n$  indicates the total time of exposure at a specific noise level and  $T_n$  indicates the reference duration for that level as given in Table G-16a of the OSHA noise regulation.<sup>(18)</sup> During any 24-hour period, a worker is allowed up to 100 percent of his daily noise dose. Doses greater than 100 percent are in excess of the OSHA PEL.

The OSHA regulation has an additional action level (AL) of 85 dB(A);

an employer shall administer a continuing, effective hearing conservation program when the TWA value exceeds the AL. The program must include monitoring, employee notification, observation, audiometric testing, hearing protectors, training, and recordkeeping. All of these requirements are included in 29 CFR 1910.95, paragraphs (c) through (o).<sup>(18)</sup> Finally, the OSHA noise standard states that when workers are exposed to noise levels in excess of the OSHA PEL of 90 dB(A), feasible engineering or administrative controls shall be implemented to reduce the workers' exposure levels.

NIOSH, in its Criteria for a Recommended Standard,<sup>(19)</sup> and the ACGIH,<sup>(20)</sup> propose exposure criteria of 85 dB(A) as a TWA for 8 hours, which is 5 dB less than the OSHA standard. The criteria also uses a more conservative 3 dB time/intensity trading relationship in calculating exposure limits. Thus, a worker can be exposed to 85 dB(A) for eight hours, but to no more than 88 dB(A) for four hours, or 91 dB(A) for two hours.

## Results

### Particulates

Figures 1, 2, 3, and 4 present graphical representations of the real-time data collected with the Met-One particle counter


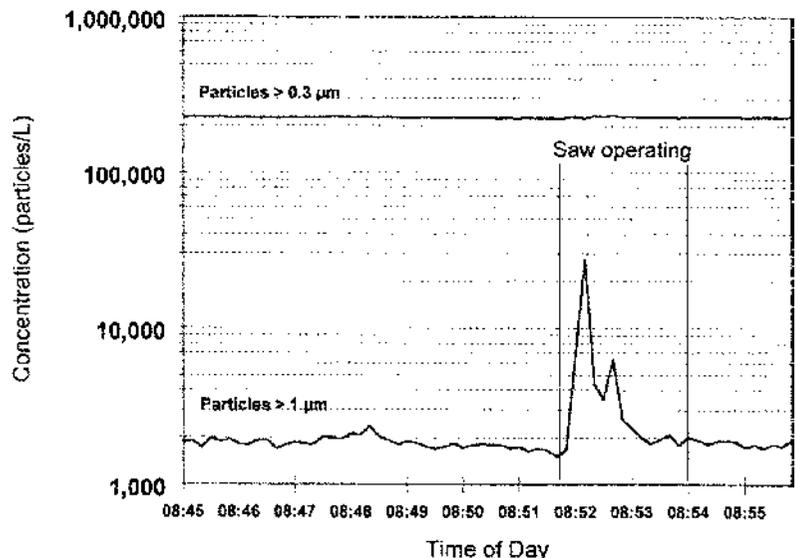


FIGURE 1  
Met-One results of autopsy 4 (electric saw).

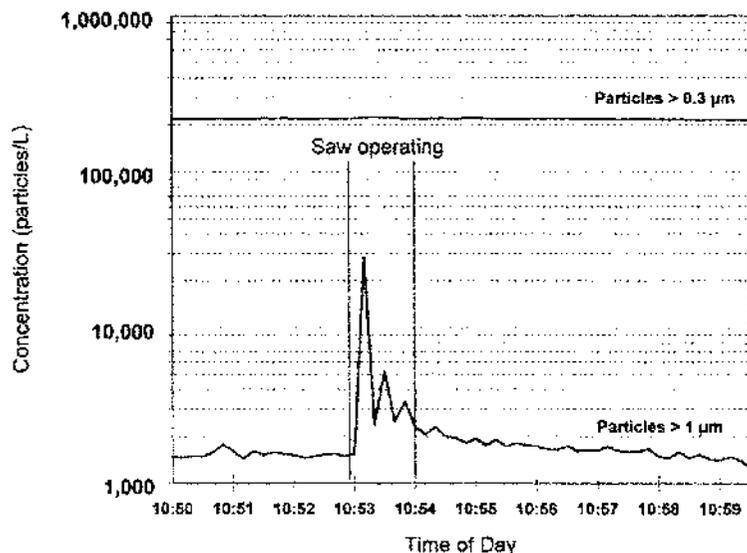


**FIGURE 2**

Met-One results of autopsy 5 (electric saw).

for four of the six monitored autopsies. Particle count measurements were made over the complete time period of each autopsy. Figures 1 and 2 depict data collected during the use of the electric saw without LEV. Figures 3 and 4 depict data collected during the use of the pneumatic saw with LEV. It is important to note that the time period for the use of the cranial saw for each monitored autopsy compo-

sed only a small portion of the entire procedure, on the order of one to two minutes. For all of the monitored autopsies, no distinctly observable effect was apparent for particles  $>0.3 \mu\text{m}$ , but for particles  $>1 \mu\text{m}$ , peaks were observable in Figures 1 and 2. These peaks corresponded to the use of the reciprocating saw on the cranial region of the decedent and ranged from one to two orders

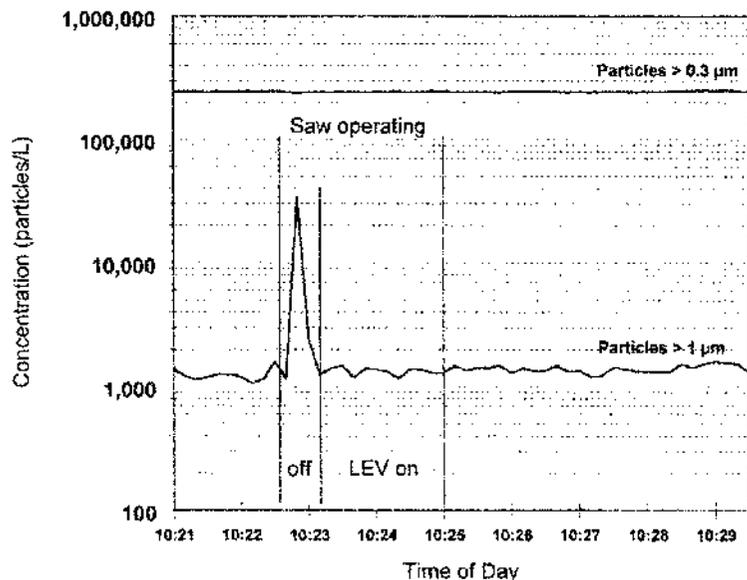


**FIGURE 3**

Met-One results of autopsy 2 (pneumatic saw with LEV).

of magnitude above the baseline. Additionally, the lack of observable peaks for particles  $>0.3 \mu\text{m}$  indicated that the diameters of particles generated by the use of the reciprocating saws predominated at  $>1 \mu\text{m}$ . It is important to note that during the second autopsy (Figure 3), the exhaust flow for the LEV was inoperable (the technician was not aware that the switch for the unit was turned off) during the first half of the time period that the pneumatic saw was used. The peak observed in Figure 3 coincides with the inoperability of the LEV.

Figures 5 and 6 present the HAM real-time measurement results collected on the operating technician during the complete time period of two individual autopsies. Note that the results from the HAM are reported as concentration estimates of particulate load (i.e., milligrams per cubic meter of air), and cannot be quantitatively compared to the other aerosol measurements reported in total counts per volume of sampled air (i.e., particles per liter). However, observation of qualitative trends can be used to understand exposure points during each autopsy. Specifically, the peaks observed in the HAM graphical representations correlate, in time, with the peaks observed in the Met-One data created by the use of the reciprocating saw.

Figures 7 and 8 present graphical representations of the real-time data collected with the Grimm particle counter for two of the six monitored autopsies (due to instrument malfunction, data was not collected for autopsy 5). As with the other real-time measurements, attempts were made to collect data over the complete time period of each autopsy. Figure 7 depicts data collected during the use of the electric saw without LEV. Figure 8 depicts data collected during the use of the pneumatic saw with LEV. For all of the monitored autopsies, minimal or reduced observable effects were apparent for particles  $>0.75 \mu\text{m}$ , but for all remaining particle cut points, peaks were observable. These peaks correspond to the use of the reciprocating saw on the cranial region of the decedent. The most significant increases in relative

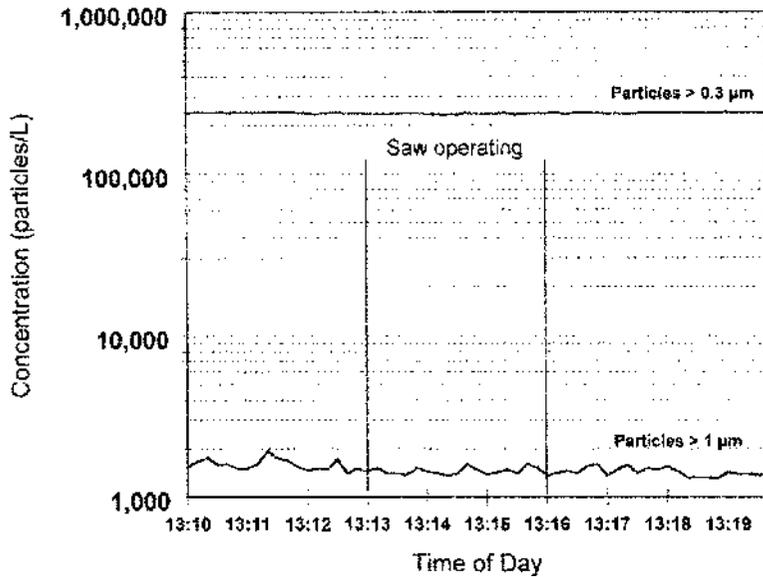

**FIGURE 4**

Met-One results of autopsy 3 (pneumatic saw with LEV).

concentrations occur for the cut points at 2, 2.5, and 3  $\mu\text{m}$ . When the electric saw was applied, observable effects were noted for all particle size cut points (except for particles  $>15 \mu\text{m}$ ) ranging from one-half to two orders of magnitude above the baseline.

*Noise*


Noise from the saws used on four cadavers was analyzed with three sets of

samples using the pneumatic saw, and one set using the electric saw. The cranial procedure took approximately 75 to 105 seconds to complete; therefore, five to seven individual spectral plots of 15-second durations were stored for analysis. Case numbers 1-3 had the technician operating the pneumatic saw, and the cranium of case number 7 was opened by two different electric saws because of a failure of the first saw during

the procedure. Inspection of the individual spectral plots revealed a general pattern of higher noise exposures associated with the earlier cutting, and lesser amounts of overall noise on successive samples. Specifically, for case number 1, the noise levels went from 92.8 to 85.6 dB(A); case number 2 levels ranged from 93.5 to 88.7 dB(A); case number 3 levels were 94.8 to 88.6 dB(A); and case number 7 ranged from 94.9 to 86.5 dB(A).


A comparison of the one-third octave band noise levels for the pneumatic and electric saws is presented in Figure 9. The spectra that are shown are average levels for the entire procedure of opening the cranium. The pneumatic saw data are from the five individual samples recorded on body number 2, while the electric saw data represents both saws used on body number 7 over the seven individual samples. The data show little difference in the noise emitted by the two types of saws. The maximum energy level for the pneumatic saw was recorded at the 4 kHz third octave band, while the maximum for the electric saw was at 5 kHz. The electric saw also had greater energy in the third octave bands, higher than 5 kHz. The average overall noise energy was slightly higher for the electric saw on both the A-weighted scale and unweighted (sound pressure level [SPL]) scale. However, these differences of 1-2 dB are not generally perceptible to normal hearing listeners.

The fluid delivery and HEPA vacuum recovery system that supports the pneumatic saw were located in the garage area adjacent to the autopsy room. The garage area was accessible through a doorway that was closed during autopsy. Employees were seen in the opposite end of the garage while the system was in use. A spectral average of the noise coming from the system was measured at a distance of approximately four feet from the vacuum, and at ear level of a standing person. The data showed that much of the noise energy was emitted at 500-4000 Hz, but that the overall levels were not in excess of any relevant criteria since the system was only on during the time when the saw was operational.

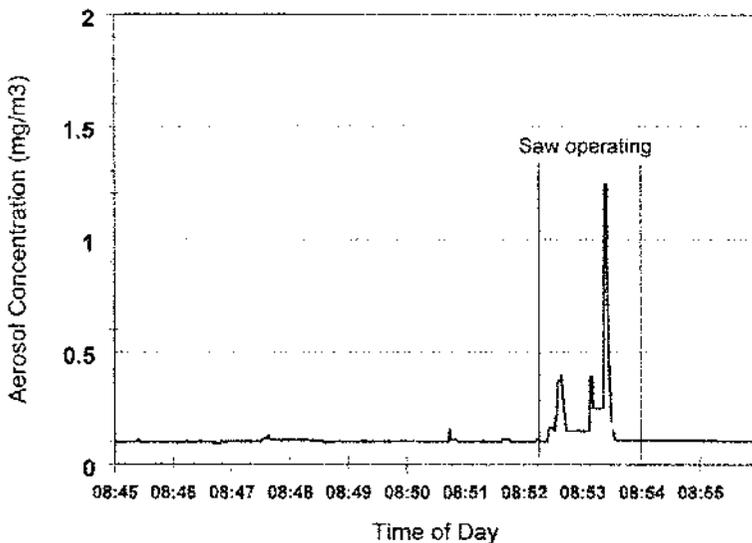

**FIGURE 5**

PBZ HAM results of autopsy 4 (electric saw).

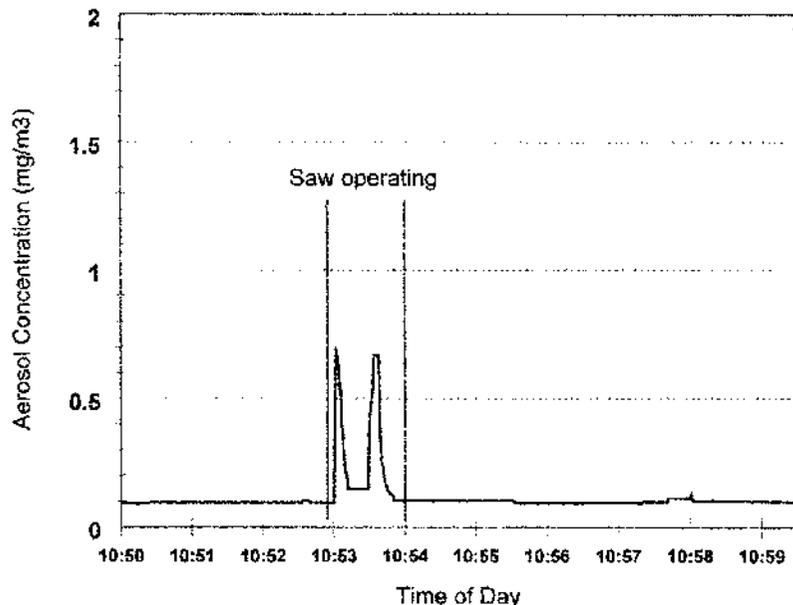

**FIGURE 6**  
PBZ HAM results of autopsy 5 (electric saw).

During the survey of the pneumatic saw, the technician seemed to be somewhat familiar with this relatively new piece of equipment. The saw was designed so that the fluid delivery system and the vacuum recovery system could be operated independent of the saw blade. That is, a deliberate effort had to be made to turn on the vacuum and fluid

systems before pressing the trigger, which would activate the blade. During the first autopsy, all of the saw's systems were operating. However, during subsequent autopsies, the fluid and vacuum systems were inadvertently turned off on the initial cut into the skull on the second autopsy, and the fluid delivery was off for the initial cut during the


third autopsy. The overall noise levels were lowest when the complete cutting system was in operation. The greatest effects of the fluid and vacuum systems on the noise were seen in the higher frequency, third-octave bands at and above 4 kHz.

## Discussion


### Particulates

The real-time measurement data collected with the Met-One and Grimm instruments (reported as particles/liter [part/L]) were similar. The baseline readings for both instruments during the sampled autopsies (for particles  $>1 \mu\text{m}$ ) were focused between 1000 and 2000 part/L. For the Grimm, data from autopsies 1 through 4 were collected as integrated one minute samples; the sample measurements for autopsies 5 and 6 were collected at six second intervals. All of the Met-One measurements were collected over 10 second intervals. The longer sample period for the earlier Grimm measurements may account for the lower comparative particle concentrations; longer sample periods result in a dampening of the peaks due to an averaging of all values over the entire sample period. Specifically, if the sample period includes numerous data points that approach the particle concentration baseline, the lower values will weight the average toward the baseline.

For all of the monitored autopsies, no distinctly observable effect is apparent for particles  $>0.3 \mu\text{m}$ , as measured by the Met-One. This is consistent with the Grimm results, which present smaller peak values (relative to the baseline) at the  $0.75 \mu\text{m}$  cut point compared to all other values at cut points of 2, 2.5, and  $3 \mu\text{m}$  over the same sample period. These reduced particle concentrations in the submicrometer size range indicated that a significant portion of the particles emitted by application of reciprocating saws are above  $1 \mu\text{m}$ . This is contrary to previously published data, which indicate median diameters in the submicrometer size range. Green and Yoshida<sup>(21)</sup> measured the aerosols generated (in the breathing zone of a pathology

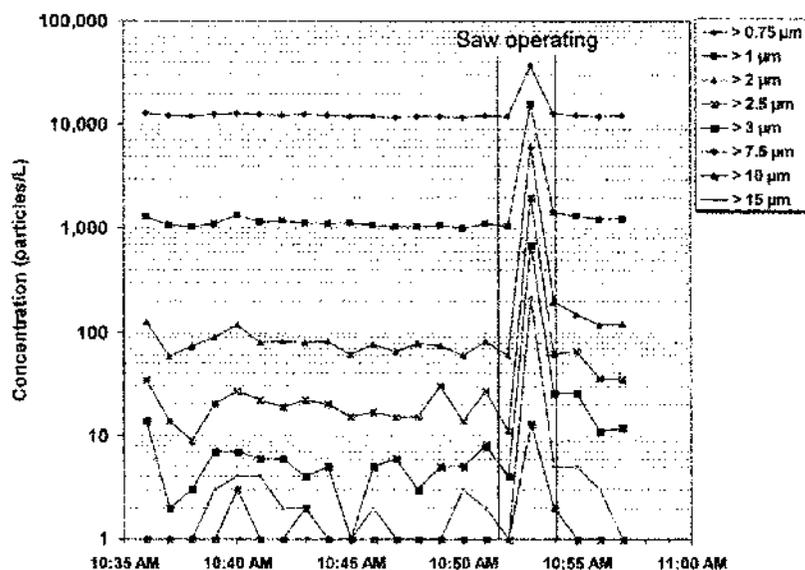

**FIGURE 7**  
Grimm results of autopsy 5 (electric saw).

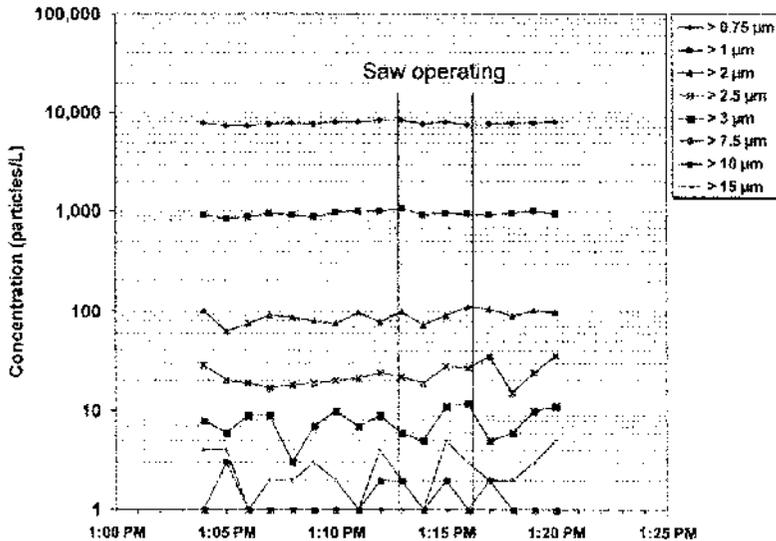

**FIGURE 8**  
Grimm results of autopsy 3 (pneumatic saw with LEV).


technician) by the application of a reciprocating saw during five cranial autopsies. The results of scanning/transmission electron microscopy indicated a median particle diameter of  $0.37 \mu\text{m}$ . In a 1992 study investigating the generation of surgical aerosols as simulated on bovine tissue, Jewett et al. reported that most of the aerosols were below  $4.2 \mu\text{m}$ , with

a peak occurring at  $0.42 \mu\text{m}$ , as measured by a 10-stage, low-pressure cascade impactor.<sup>(22)</sup> However, in a follow-up investigation evaluating occupational exposures collected in the breathing zone (using personal cascade impactors with cut points at  $0.52$ ,  $3.5$ , and  $14.8 \mu\text{m}$ ), Heinsohn and Jewett reported the detection of hemoglobin in a smaller percent-


age of the samples at a particle size of  $0.52 \mu\text{m}$  (38% versus 90% detected at  $14.7 \mu\text{m}$ ).<sup>(23)</sup>

The particulate peaks observed during autopsies 2, 4, and 5 indicate that the application of LEV has a significant effect on reducing the aerosols produced by the reciprocating saws. Additionally, the peak observed during autopsy 2 (use of the pneumatic saw while the LEV was inoperable) confirms that the reduction in aerosol emission results from the LEV, and not from the use of the pneumatic saw versus the electric saw. The aerosol concentrations observed from use of both saws without LEV can be one to two orders of magnitude over baseline. The peaks observed from the personal real-time air samples collected on the operating technician with the HAM indicate that aerosols generated by use of the unventilated reciprocating saws were capable of reaching the breathing zone of the worker.

The real-time instrumentation compared favorably with the filter cassette samples collected by the county health department. As shown in Figure 10, there was a consistent reduction in the concentration levels (reported as fragments [as determined by optical microscopy] per liter of air) between the application of the electric saw and the pneumatic saw equipped with LEV. The largest differential was observed for the right area sample and the personal breathing zone (PBZ) sample collected on the forensic technician. The PBZ sample collected on the pathologist exhibited the lowest differential margin; the pathologist did not use the reciprocating saw and was generally located opposite of, and approximately three feet from, the forensic technician. The dissimilar concentrations between the left and right area samples can be explained by the direction of air flow in the room. The auxiliary exhaust units were located in the ceiling nearer to the entry door of the room. This placement of the exhaust air vent would cause a pressure differential resulting in movement from left to right across the operating table. Therefore, particles generated by the application of

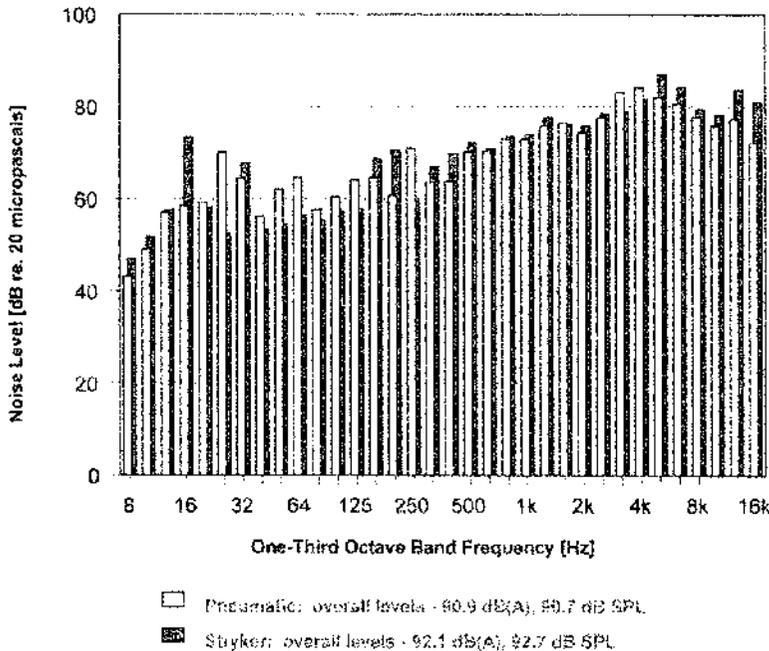

**FIGURE 9**  
Noise levels for pneumatic versus electric saw.

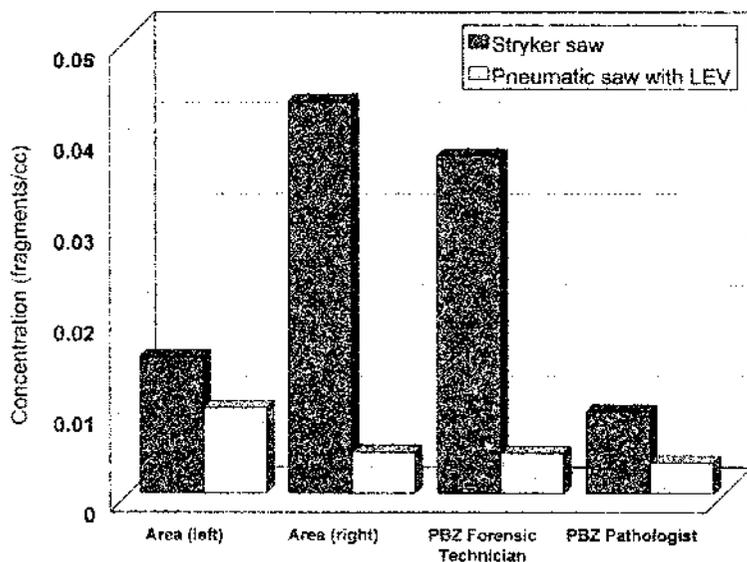

**FIGURE 10**

Filter cassette sampling results comparing bone and tissue fragment concentrations for different reciprocating saws.

the reciprocating saw would drift to the right.

#### Noise

The noise data from the two types of reciprocating saws revealed that the noise levels should not exceed the evaluation criteria for hazardous noise exposure. Although levels can approach 95 dB(A), the greatest 15-second sample recorded during the evaluation, the short amount of time during which the physician or technician was subjected to the noise lowers the TWA value below all the criteria. Even the most conservative exposure criteria of NIOSH and the ACGIH allow exposure to 95 dB(A) for a total time of slightly less than one hour.<sup>(19,20)</sup> The exposure times measured in the survey were on the order of two minutes or less for each autopsy. It is unlikely that employees would perform 30 autopsies per day.

#### Conclusions

The health care industry poses unique occupational exposure concerns including exposure to pathogenic agents in blood and other fluids. HIV has been shown to remain viable in the cool aerosols generated by certain surgical tools.<sup>(24)</sup> In addition, researchers have

demonstrated the ability of HIV to survive several hours to 16 days post-mortem, and has been detected several days outside of a host.<sup>(25,26)</sup> Due to the invasive nature of the procedures used in the operating theater, and the aerosol-generating potential of specific surgical instruments (i.e., harmonic scalpels, electro-cautery knives, lasers, and reciprocating saws), there is an increased risk of exposure to aerosols that may contain infectious agents (i.e., *Mycobacterium tuberculosis*). These same risks are encountered during the conduct of autopsies. Additionally, during an autopsy, the HIV status of a decedent, or the diagnosis of tuberculosis or other infectious diseases may not be known. Therefore, it is prudent to evaluate the risks prior to each case and employ appropriate control strategies to minimize the potential for occupational exposures.

The objective of this NIOSH investigation was to determine if the alternative reciprocating saw 1) generates less tissue and bone fragment aerosol that could potentially challenge the breathing zone of the operating forensic technician, and 2) reduces the noise exposure to the technician and surrounding personnel. Real-time, light-scattering instruments were used to monitor transient peaks of gen-

erated particles during the performance of autopsies. For the NIOSH data, no attempt was made to determine the exact contribution of blood and/or tissue fragments to the observed particle concentrations. However, it can be assumed that the generated aerosols are predominantly composed of constituents from the cadaver (i.e., tissue, bone, blood, and water). In contrast, the filter cassette samples collected by the county health department were analyzed for bone and tissue fragments.

The particulate peaks observed during three of the monitored autopsies conducted without the aide of LEV indicate that the application of LEV has a significant effect on reducing the aerosols produced by the reciprocating saws. Additionally, the peaks observed from the personal real-time air samples collected on the operating technician with the handheld aerosol monitor indicate that aerosols generated by use of the unventilated reciprocating saws are capable of reaching the breathing zone of the worker, and are in the respirable size range. The noise data from the two types of reciprocating saws reveal that the noise levels should not exceed the evaluation criteria for hazardous noise exposure.

The extra bulkiness resulting from the extension of the pneumatic lines, and the exhaust ventilation tubing created a number of ergonomic issues. Awkward postures imposed by the trailing lines resulted in a two-fold increase in the time to conduct the cranial cuts. The ergonomic implications could result in a lack of acceptance of the modified device among the professional forensic community.

As observed during this investigation, operator error can result in occupational exposures to aerosols. Therefore, it is recommended that respirators continue to be applied under the current program to protect against inadvertent exposures to infectious aerosols. During the time of the NIOSH investigation, county coroner department policies required the use of HEPA filtered particulate half-face respirators (at a minimum,

hooded, powered air-purifying respirators were also available), double gloves, caps, gowns, and shoe coverings for autopsies conducted in the high risk room. For respirator use, OSHA requires a respiratory protection program that includes the following components: written standard operating procedures, user instruction and training, cleaning and disinfection, storage, inspection, surveillance of work area conditions, evaluation of respirator protection program, medical review, and use of certified respirators.<sup>(27)</sup>

## REFERENCES

- Francis, J.: Curry National Tuberculosis Center On-Site Consultation Report: Prevention and Control of Tuberculosis at Los Angeles County Department of Coroner. San Francisco, CA (1996).
- National Institute for Occupational Safety and Health: Guidelines for Protecting the Safety and Health of Health Care Workers. U.S. Department of Health and Human Services, Public Health Service, Centers for Disease Control, NIOSH, DHHS (NIOSH) Publication No. 88-119, Cincinnati, OH (1988).
- Centers for Disease Control and Prevention: Guidelines for Preventing the Transmission of *Mycobacterium tuberculosis* in Health Care Facilities. MMWR 43(No. RR-13) (1994).
- Centers for Disease Control and Prevention: Guidelines for Prevention of Transmission of Human Immunodeficiency Virus and Hepatitis B Virus to Health-Care and Public-Safety Workers. MMWR 38(No. S-6) (1989).
- 56 Fed. Reg. 235: Occupational Safety and Health Administration: Occupational Exposure to Bloodborne Pathogens; Final Rule. 29 CFR 1910.1030 (1991).
- Occupational Safety and Health Administration: Enforcement Procedures and Scheduling for Occupational Exposures to Tuberculosis. CPL 2.106. U.S. Department of Labor, OSHA, Office of Health Compliance Assistance, Washington, DC (1996).
- Healing, T.D.; Hoffman, P.N.; Young, S.E.J.: The Infection Hazards of Human Cadavers. Communicable Disease Report 5(5):R61-R68 (1995).
- Young, S.E.J.; Healing, T.D.: Infection in the Deceased: A Survey of Management. Communicable Disease Report 5(5):R69-73 (1995).
- Nolte, K.B.; Foucar, K.; Richmond, J.Y.: Hantaviral Biosafety Issues in the Autopsy Room and Laboratory: Concerns and Recommendations. Human Pathology 27(12):1253-1254 (1996).
- Sugita, M.; Tsusumi, Y.; Suchi, M.; et al.: Pulmonary Tuberculosis: An Occupational Hazard for Pathologists and Pathology Technicians in Japan. Acta Pathologica Japonica 4(2):116-127 (1990).
- Templeton, G.L.; Illing, L.A.; Young L.; et al.: The Risk for Transmission of *Mycobacterium tuberculosis* at the Bedside and During Autopsy. Annals of Internal Medicine 122(12):922-925 (1995).
- Kantor, H.S.; Poblete, R.; Pusateri, S.L.: Nosocomial Transmission of Tuberculosis from Unsuspected Disease. American Journal of Medicine 84:833-837 (1988).
- Lundgren, R.; Norman, E.; Asberg, I.: Tuberculosis Infection Transmitted at Autopsy. Tubercule 68:147-150 (1987).
- American Society for Heating, Refrigerating, and Air-Conditioning Engineers: Health Facilities. In: ASHRAE Applications Handbook. ASHRAE, Chapter 7, Atlanta, GA (1991).
- American Institute of Architects: Guidelines for Construction and Equipment of Hospital and Medical Facilities. AIA, Waldorf, MD (1987).
- Ward, W.D.: Anatomy & Physiology of the Ear: Normal and Damaged Hearing. In: Berger E.H., Ward W.D., Morrill J.C., Royster L.H., eds. Noise & Hearing Conservation Manual, 4th ed., pp 177-195, American Industrial Hygiene Association, Akron, OH (1986).
- Suter, A.H.: The Ability of Mildly Hearing-Impaired Individuals to Discriminate Speech in Noise. U.S. Environmental Protection Agency, Joint EPA/USAF Study, EPA 550/9-78-100, AMRL-TR-78-4, Washington, DC (1978).
- Code of Federal Regulations: OSHA. 29 CFR 1910.95. U.S. Government Printing Office, Federal Register, Washington, DC (1992).
- National Institute for Occupational Safety and Health: Criteria for a Recommended Standard: Occupational Noise Exposure (revised criteria 1998). Cincinnati, OH: U.S. Department of Health and Human Services, Public Health Service, Center for Disease Control and Prevention, NIOSH, DHHS (NIOSH) Publication No. 98-126 (1998).
- American Conference of Governmental Industrial Hygienists: TLVs and BEIs: Threshold Limit Values for Chemical Substances and Physical Agents. ACGIH, Cincinnati, OH (2000).
- Green, F.H.Y.; Yoshida, K.: Characteristics of Aerosols Generated During Autopsy Procedures and Their Potential Role as Carriers of Infectious Agents. Appl Occup Environ Hyg 5:853-858 (1990).
- Jewett, D.L.; Heinsohn, P.; Bennett, C.; et al.: Blood-Containing Aerosols Generated by Surgical Techniques: A Possible Infectious Hazard. Am Ind Hyg Assoc J 53:228-231 (1992).
- Heinsohn, P.; Jewett, D.L.: Exposure to Blood-Containing Aerosols in the Operating Room: A Preliminary Study. Am Ind Hyg Assoc J 54:446-453 (1993).
- Johnson, G.K.; Robinson, W.S.: Human Immunodeficiency Virus-1 (HIV-1) in the Vapors of Surgical Power Instruments. Journal of Medical Virology 33:47-50 (1991).
- Douceron, H.; Deforges, L.; Gherardi, R.; et al.: Long-Lasting Postmortem Viability of Human Immunodeficiency Virus: A Potential Risk in Forensic Medicine Practice. Forensic Science International 60:61-66 (1993).
- Resnick, L.; Veren, K.; Salahuddin, Z.; et al.: Stability and Inactivation of HTLV-III/LAV Under Clinical and Laboratory Environments. JAMA 255(14):1887-1891 (1986).
- Code of Federal Regulations: OSHA Respiratory Protection. 29 CFR 1910.134. U.S. Government Printing Office, Federal Register, Washington, DC (1992).

---

**EDITORIAL NOTE:** Kenneth Martinez and Randy L. Tubbs are with the Hazard Evaluation and Technical Assistance Branch of NIOSH. Philip Ow, Occupational Environmentalist, is with the County of Los Angeles, Department of Human Resources, 3333 Wilshire Blvd., Los Angeles, California. More detailed information on this evaluation is contained in Health Hazard Evaluation Report No. 96-0019-2666, available through NIOSH, Hazard Evaluation and Technical Assistance Branch, 4676 Columbia Parkway, Cincinnati, Ohio 45226; telephone: (800) 35-NIOSH; fax: (513) 533-8573.

---